



### Case 1D: TOC @ Clifton Court Forebay

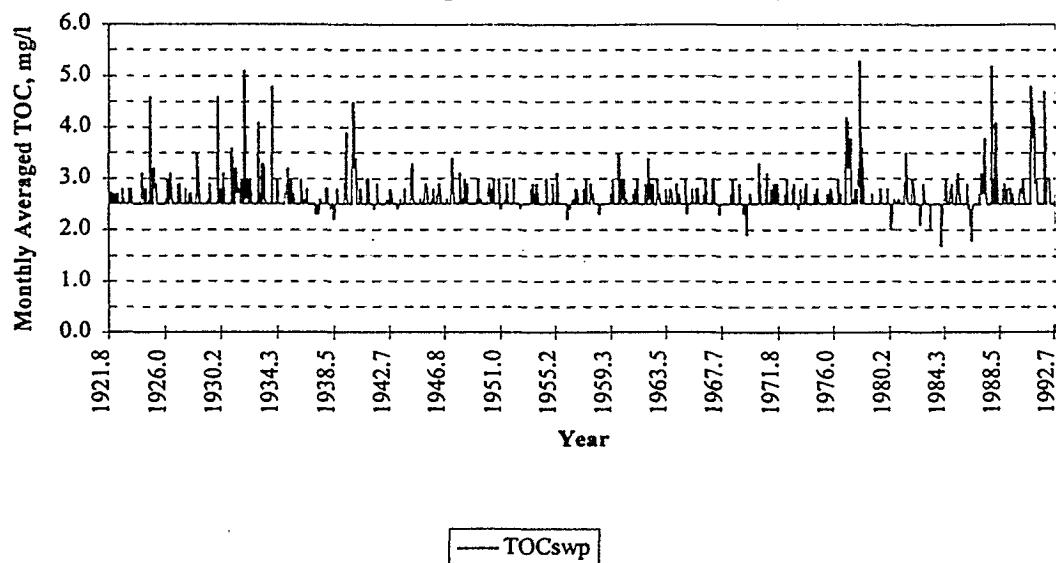

### Case 1D: TOC for Export Water

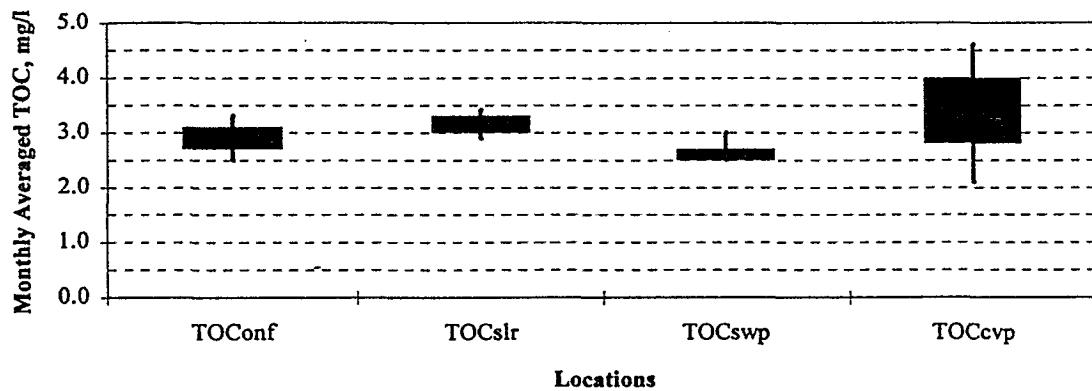

	TOConf	TOCsir	TOCswp	TOCcvp
Max	5.6	4.2	5.3	7.1
99%	4.2	3.7	4.4	5.9
90%	3.3	3.4	3.0	4.6
75%	3.1	3.3	2.7	4.0
25%	2.7	3.0	2.5	2.8
10%	2.5	2.9	2.5	2.1
1%	2.1	2.7	2.2	1.3
Min	1.7	2.6	1.7	0.8
Average	2.9	3.1	2.6	3.4

Key:  
 TOConf = TOC at O'Neill Forebay  
 TOCsir = TOC at San Luis Reservoir  
 TOCswp = TOC at Clifton Court  
 Forebay (blended supply  
 from isolated canal and  
 south Delta pumping)  
 TOCcvp = TOC at Delta Mendota  
 Canal Intake (blended  
 supply from isolated canal  
 and south Delta pumping)